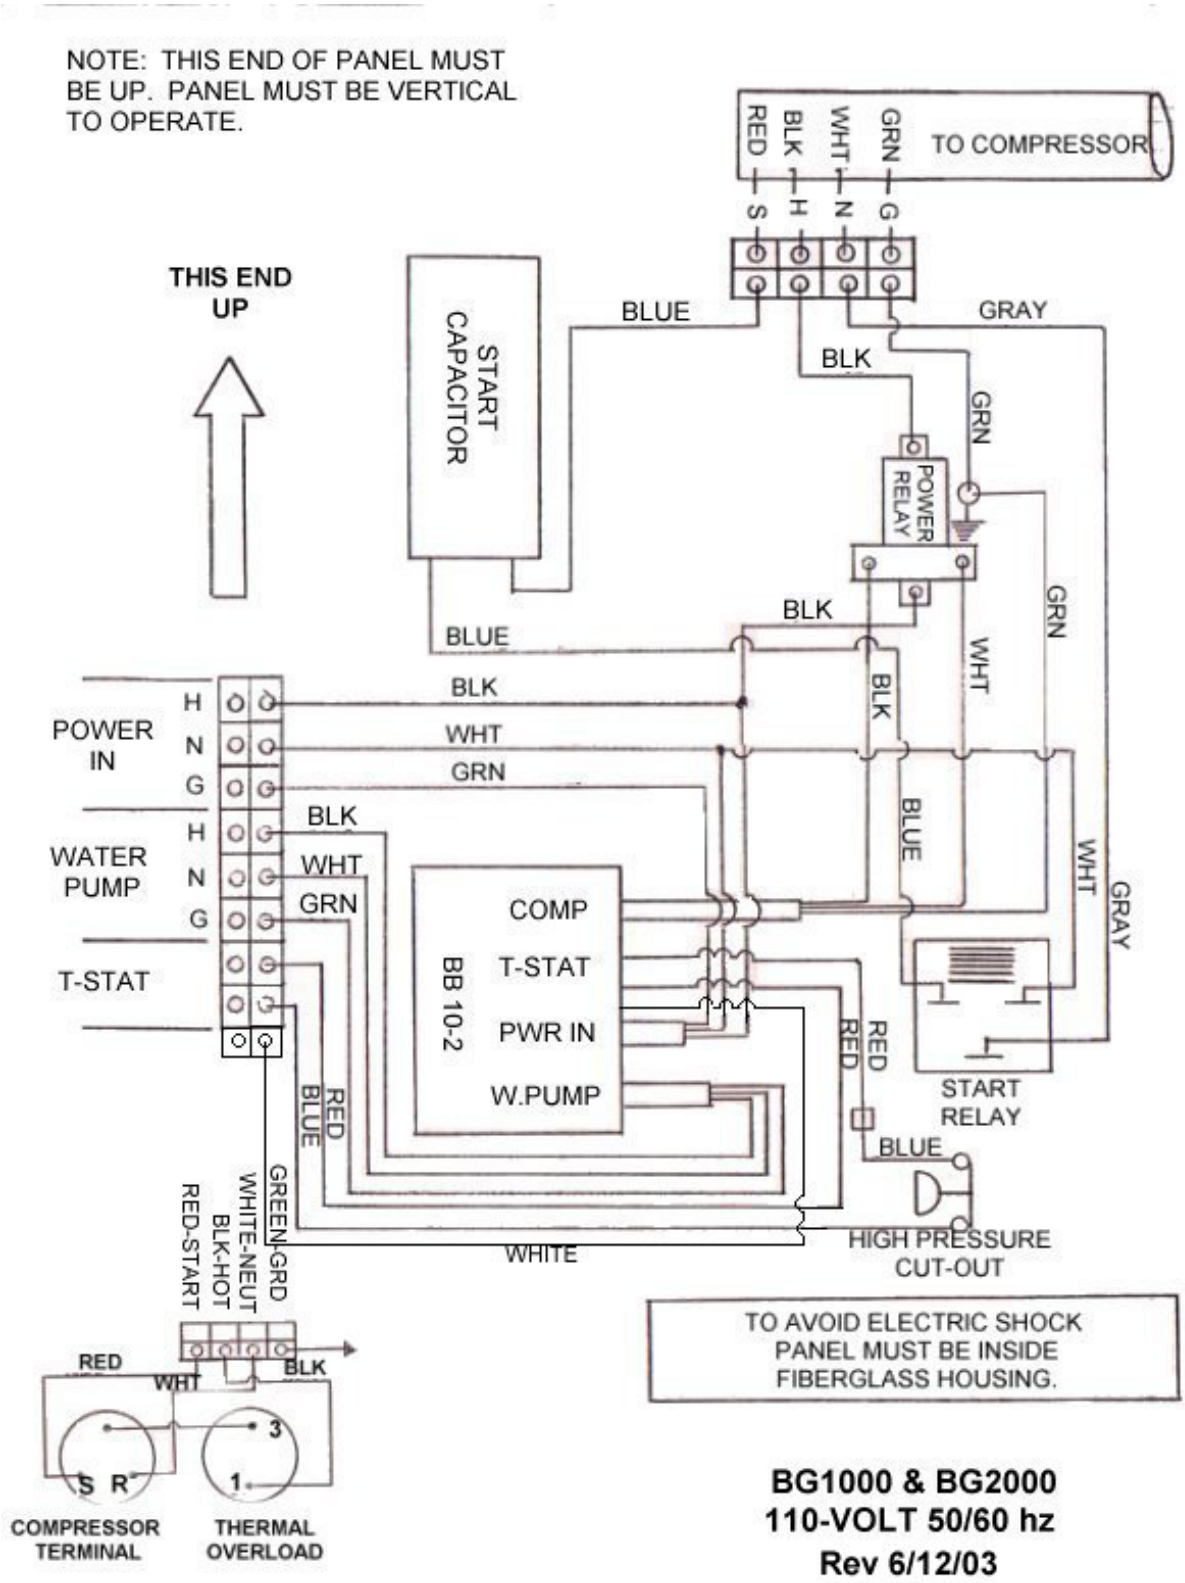
NOTE: THIS END OF PANEL MUST BE UP. PANEL MUST BE VERTICAL TO OPERATE.
THIS END UP
TO COMPRESSOR
RED
BLK
WHT
GRN
S
H
N
G
START CAPACITOR
BLUE
GRAY
BLK
GRN
POWER RELAY
BLK
GRN
BLUE
WHT
BLK
BLK
WHT
GRN
POWER IN
H
N
G
WATER PUMP
H
N
G
T-STAT
BLK
WHT
GRN
BLUE
WHT
GRAY
COMP
T-STAT
PWR IN
W.PUMP
BB 10-2
RED
RED
START RELAY
RED
BLUE
BLUE
HIGH PRESSURE CUT-OUT
GREEN-GRD
WHITE-NEUT
BLK-HOT
RED-START
WHITE
TO AVOID ELECTRIC SHOCK PANEL MUST BE INSIDE FIBERGLASS HOUSING.
RED
WHT
BLK
3
S
R
1
COMPRESSOR TERMINAL
THERMAL OVERLOAD
BG1000 & BG2000
110-VOLT 50/60 hz
Rev 6/12/03