


TO AVOID ELECTRIC SHOCK
PANEL MUST BE MOUNTED
INSIDE CABINET.

PANEL UP ARROW MUST
BE UP TO OPERATE
START RELAY.

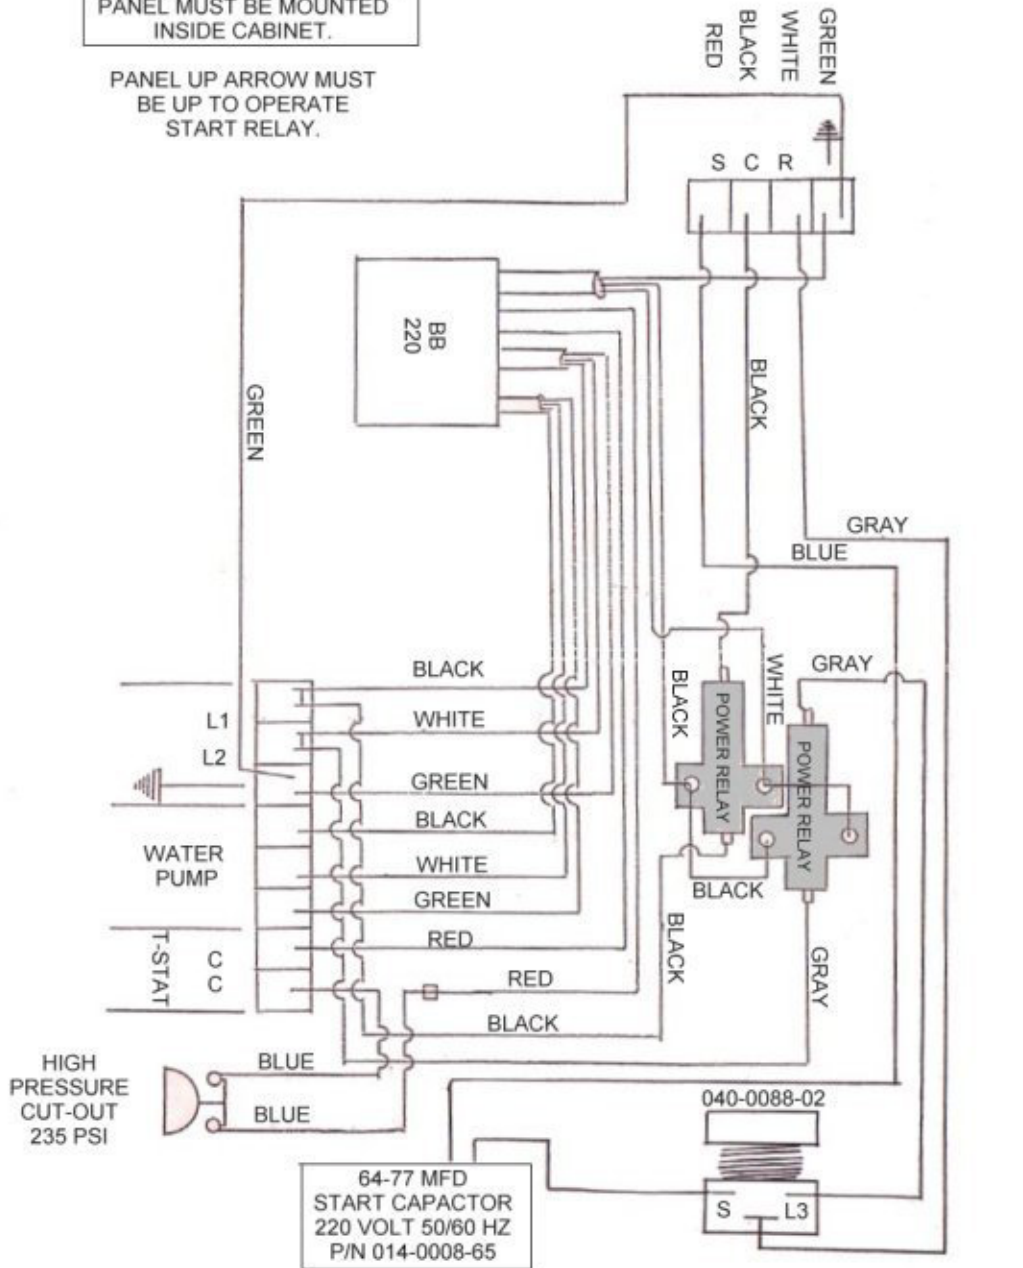

BG 1000
220 VOLT 50/60 HZ
Rev 4/04/03